




# Trenching

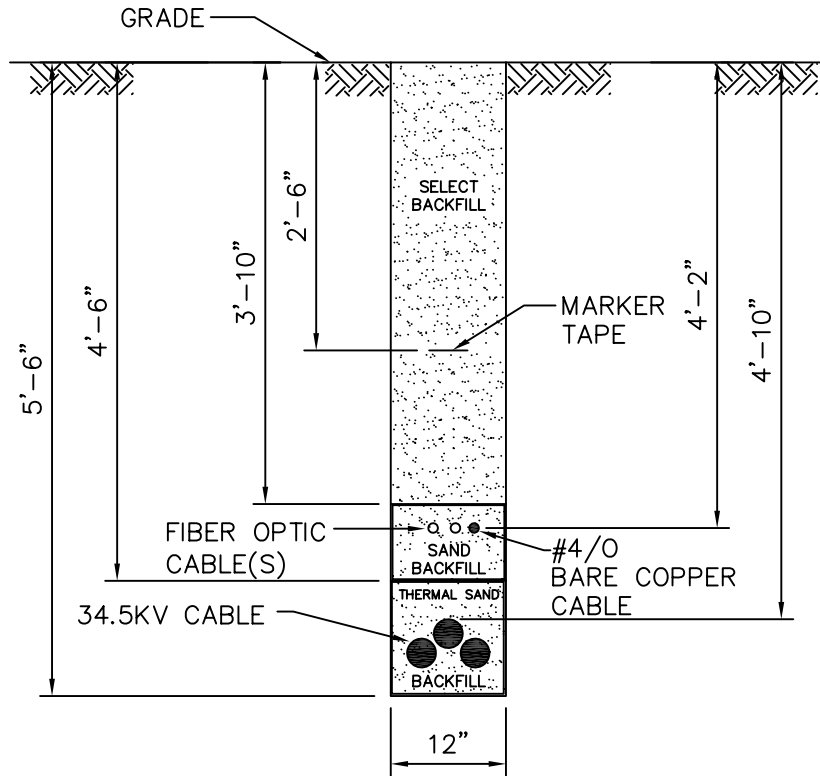

TYPICAL 5'-6" TRENCH CROSS SECTION  
SINGLE CIRCUIT

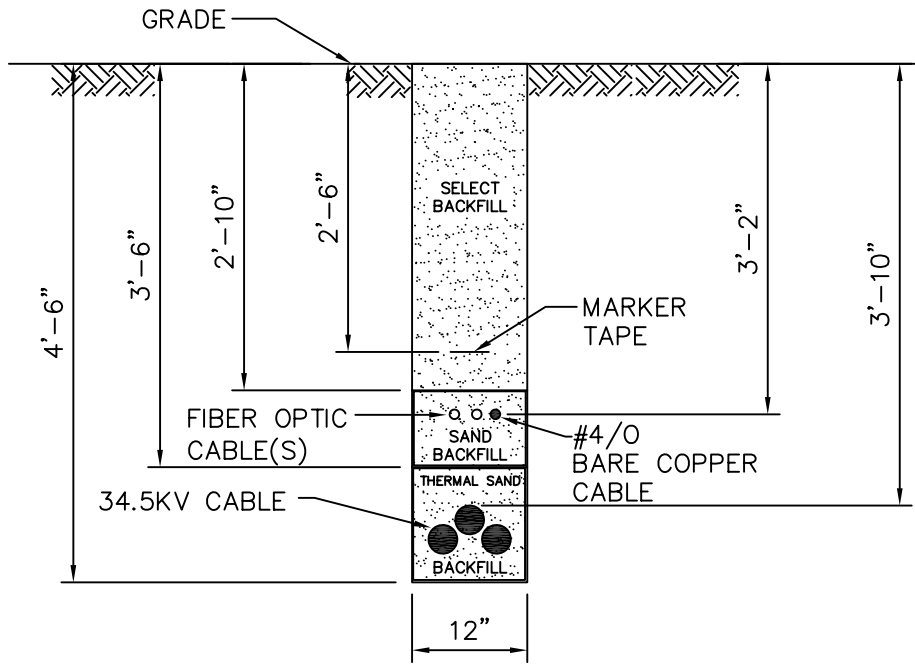

TYPICAL 4'-6" TRENCH CROSS SECTION  
SINGLE CIRCUIT

 <p style="font-size: small;">400 BLUE HILL DRIVE, WESTWOOD, MA 02090 www.carebapower.com; www.mottmac.com</p>	<p>NOBLE BALL HILL WINDPARK 34.5KV &amp; FIBER OPTIC CABLES CROSS SECTION OF UNDERGROUND TRENCH</p>	SCALE N.T.S.	DEPT. ELEC	NO. 0704506	DATE CREATED 07/09/08
		DATE ISSUED 07/10/08	DRAWING NO. BH-E-SK6		REV A