




Trenching

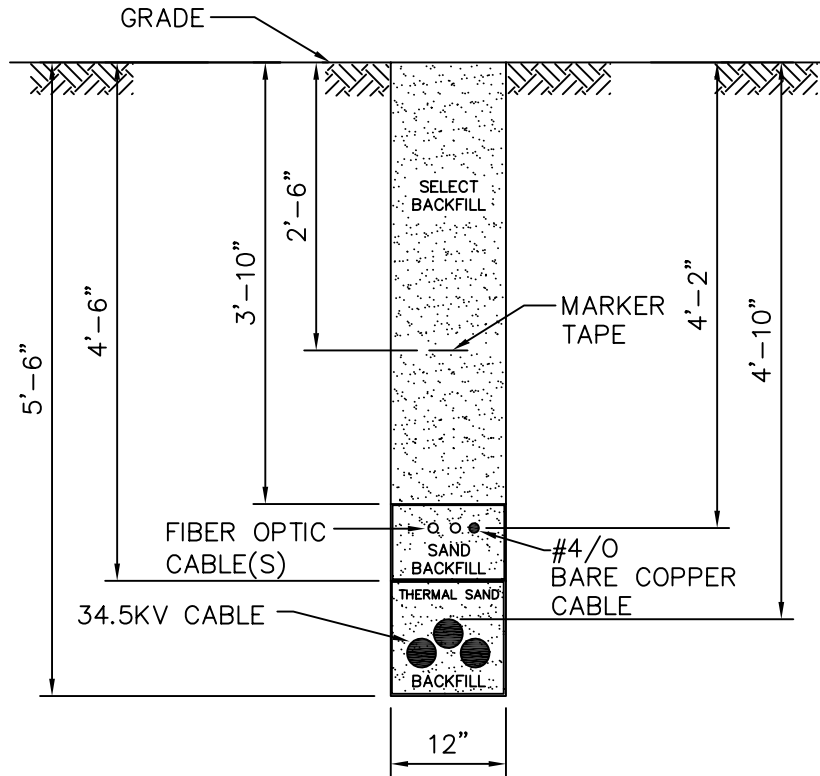

TYPICAL 5'-6" TRENCH CROSS SECTION
SINGLE CIRCUIT

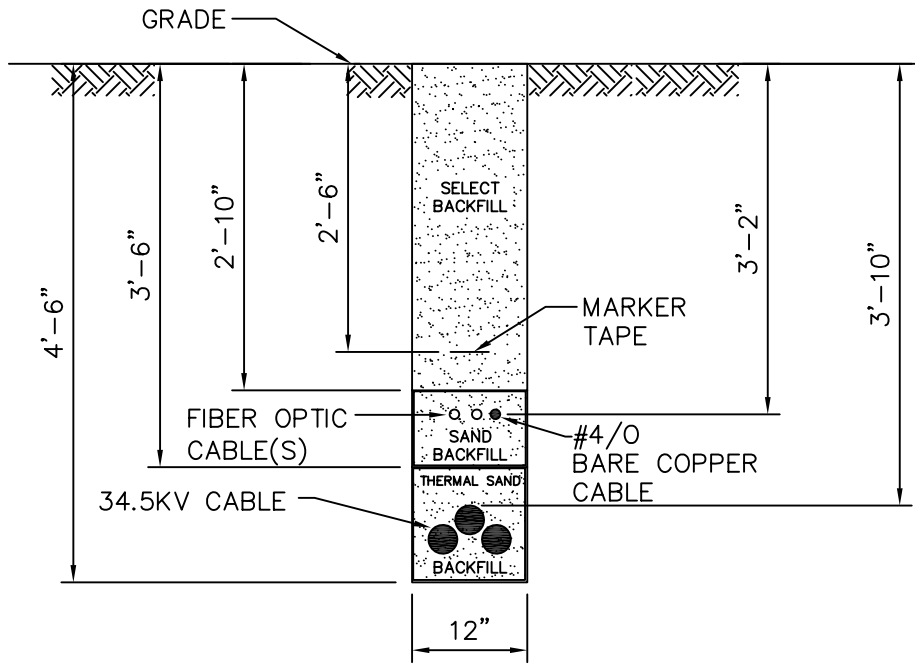

TYPICAL 4'-6" TRENCH CROSS SECTION
SINGLE CIRCUIT

 400 BLUE HILL DRIVE, WESTWOOD, MA 02090 www.carebapower.com; www.mottmac.com	NOBLE BALL HILL WINDPARK 34.5KV & FIBER OPTIC CABLES CROSS SECTION OF UNDERGROUND TRENCH	SCALE	DEPT.	NO.	DATE CREATED
		DATE ISSUED	DRAWING NO.		REV
		N.T.S.	ELEC	0704506	07/09/08
		07/10/08	BH-E-SK6		A